


|                                     | Value | Norm  | Std Dev | Dev Norm |
|-------------------------------------|-------|-------|---------|----------|
| SNA (°)                             | 77.5  | 82.0  | 3.5     | -1.3 *   |
| SNB (°)                             | 72.6  | 80.0  | 3.0     | -2.5 **  |
| ANB (°)                             | 4.9   | 2.0   | 2.4     | 1.2 *    |
| Wits Appraisal (mm)                 | 2.2   | -1.0  | 1.0     | 3.2 ***  |
| Facial Axis-Ricketts (NaBa-PtGn)(°) | 88.1  | 90.0  | 3.5     | -0.5     |
| Cranio-Mx Base/SN-Palatal Plane (°) | 7.8   | 7.3   | 3.5     | 0.1      |
| SN - GoGn (°)                       | 36.7  | 32.9  | 5.2     | 0.7      |
| Pog - NB (mm)                       | 2.1   | 1.7   | 1.7     | 0.2      |
| SN-FOP (°)                          | 22.4  | 19.0  | 4.0     | 0.9      |
| U1 - NA (mm)                        | 6.6   | 4.3   | 2.7     | 0.8      |
| U1 - NA (°)                         | 23.8  | 22.8  | 5.7     | 0.2      |
| L1 - NB (mm)                        | 5.6   | 4.0   | 1.8     | 0.9      |
| L1 - NB (°)                         | 26.5  | 25.3  | 6.0     | 0.2      |
| Interincisal Angle (U1-L1) (°)      | 124.7 | 130.0 | 6.0     | -0.9     |
| L1 Protrusion (L1-APo) (mm)         | 1.7   | 2.7   | 1.7     | -0.6     |
| U6 - PT Vertical (mm)               | 17.2  | 14.7  | 3.0     | 0.8      |
| UFH (Na-ANS) (%)                    | 43.0  | 46.0  | 5.0     | -0.6     |
| LFH (ANS-Me    FH) (%)              | 57.0  | 54.0  | 5.0     | 0.6      |

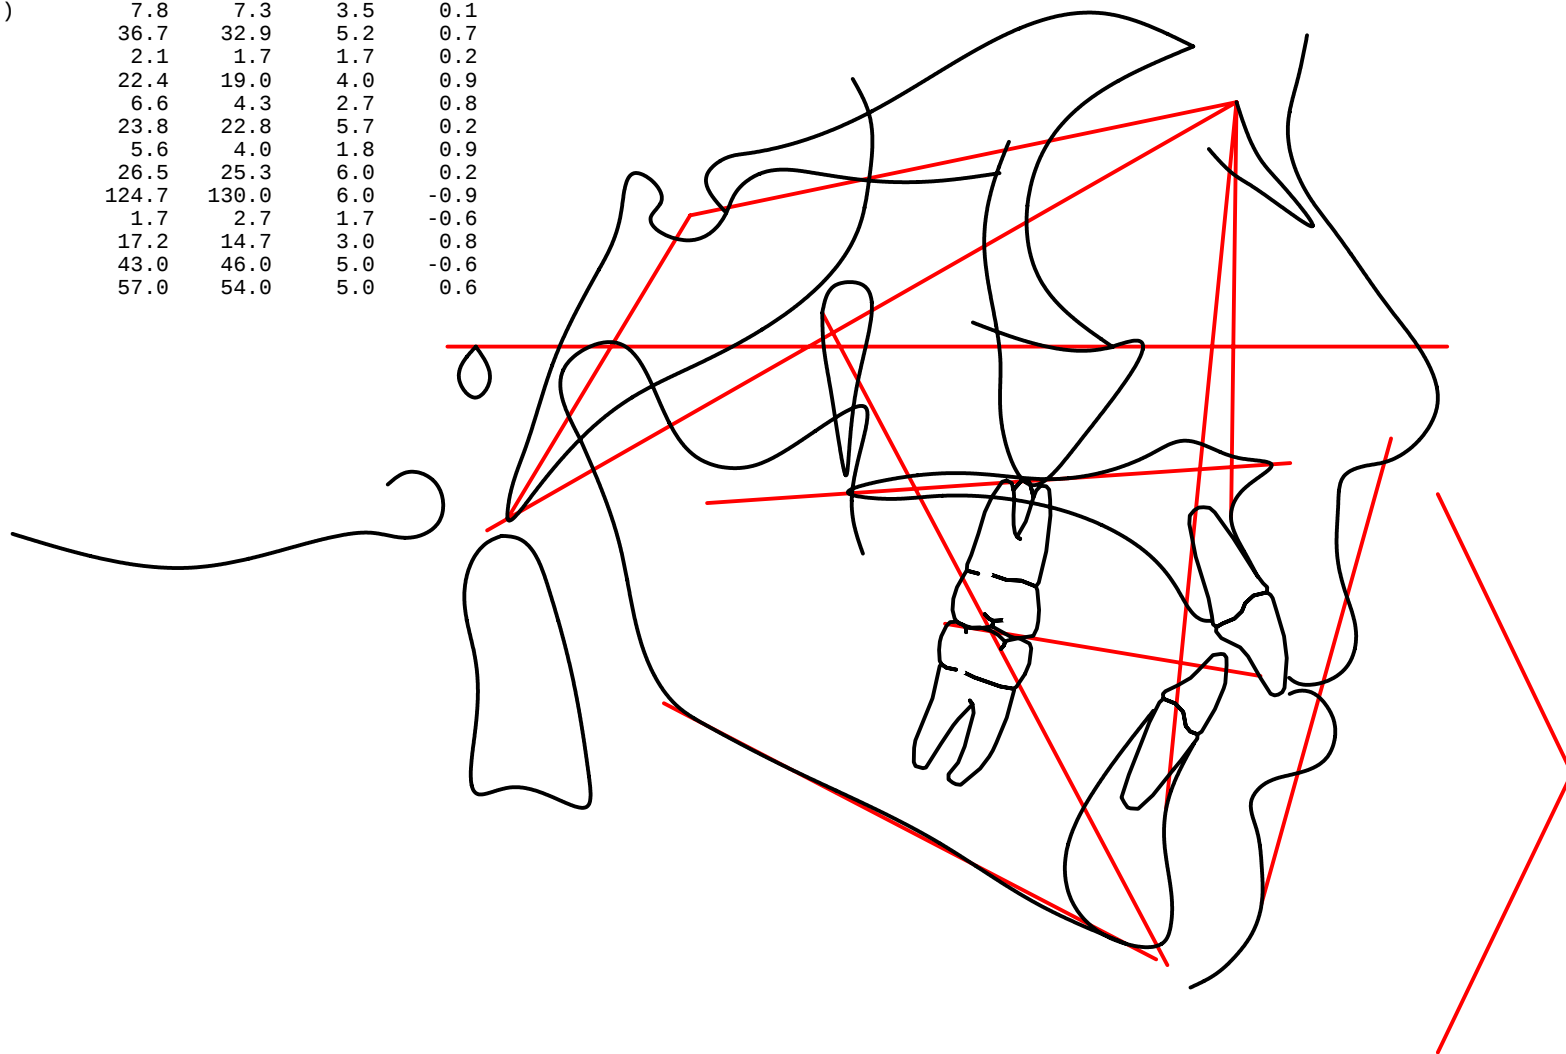

Colors indicate deviations from the norm as follows:

Black: a deviation less than or equal to 1.

Green: a deviation greater than 1 and less than or equal to 2.

Blue: a deviation of greater than 2 and less than or equal to 3.

Red: a deviation of greater than 3.

NOTE: This information is suggestive only. Any diagnosis and prescription should be the decision and sole responsibility of the doctor using this material.